

**MODEL:** CBL-UA-MB-1 | **DESCRIPTION:** USB CABLE**FEATURES**

- USB 2.0
- type A male to type mini B male
- 1 meter
- PVC jacket

**SPECIFICATIONS**


parameter	conditions/description	min	typ	max	units
rated voltage			20		Vdc
rated current				1	A
conductor resistance				3	$\Omega$
insulation resistance	at 300 Vdc / 10 ms	10			M $\Omega$
operating temperature		-20		80	$^{\circ}$ C
storage temperature		-25		80	$^{\circ}$ C
flammability rating	UL94V-0				
RoHS	yes				

## MECHANICAL DRAWING


units: mm  
 tolerance:  
 X.X ±0.2 mm  
 X.XX ±0.15 mm  
 unless otherwise noted

critical dimension: ▼

ITEM	DESCRIPTION	MATERIAL	PLATING/COLOR
1	cable	28 AWG OD: 3.5 mm, PVC	black
2	connector 1	USB 2.0 Type A	shell: nickel term.: gold flash
3	USB A over mold	PVC 45P	black
4	connector 2	USB 2.0 Mini Type B	shell: nickel term.: gold flash
5	USB mini B inner mold	LD-PE	black
6	USB mini B over mold	PVC 45P	black

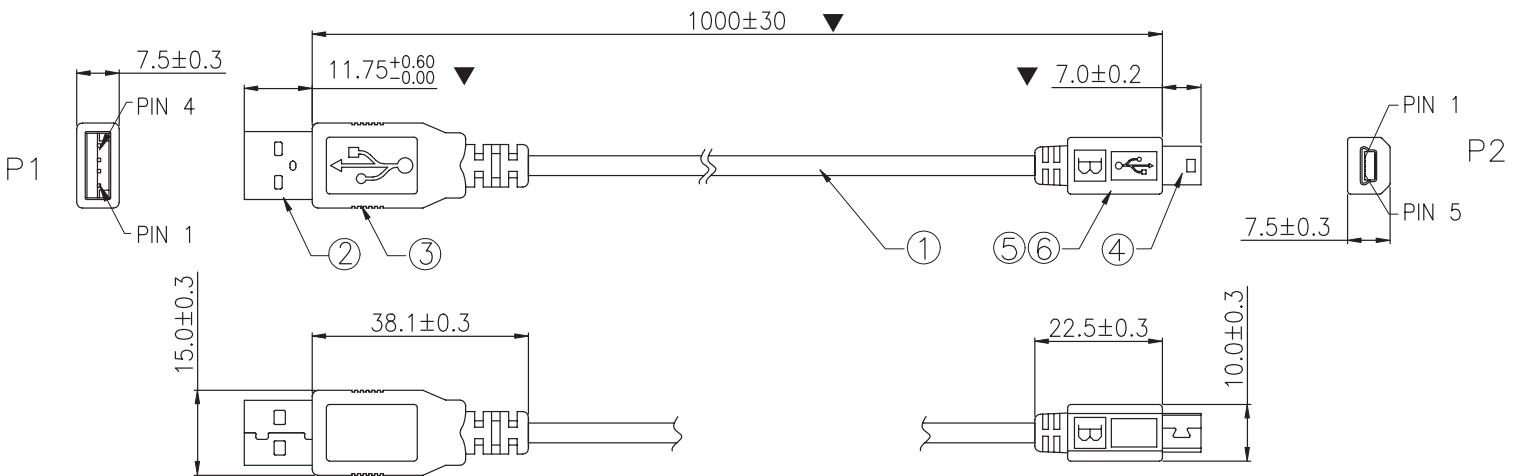


Pin Assignment

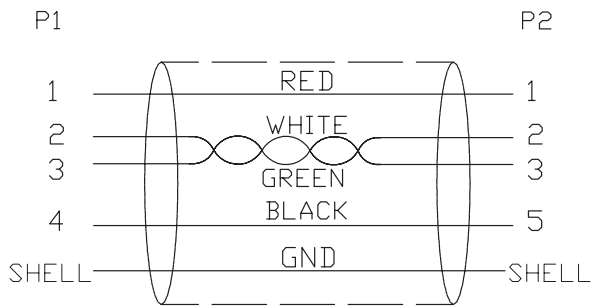

## PACKAGING

units: mm

Carton Size: 470 x 330 x 235 mm  
Carton QTY: 500 pcs

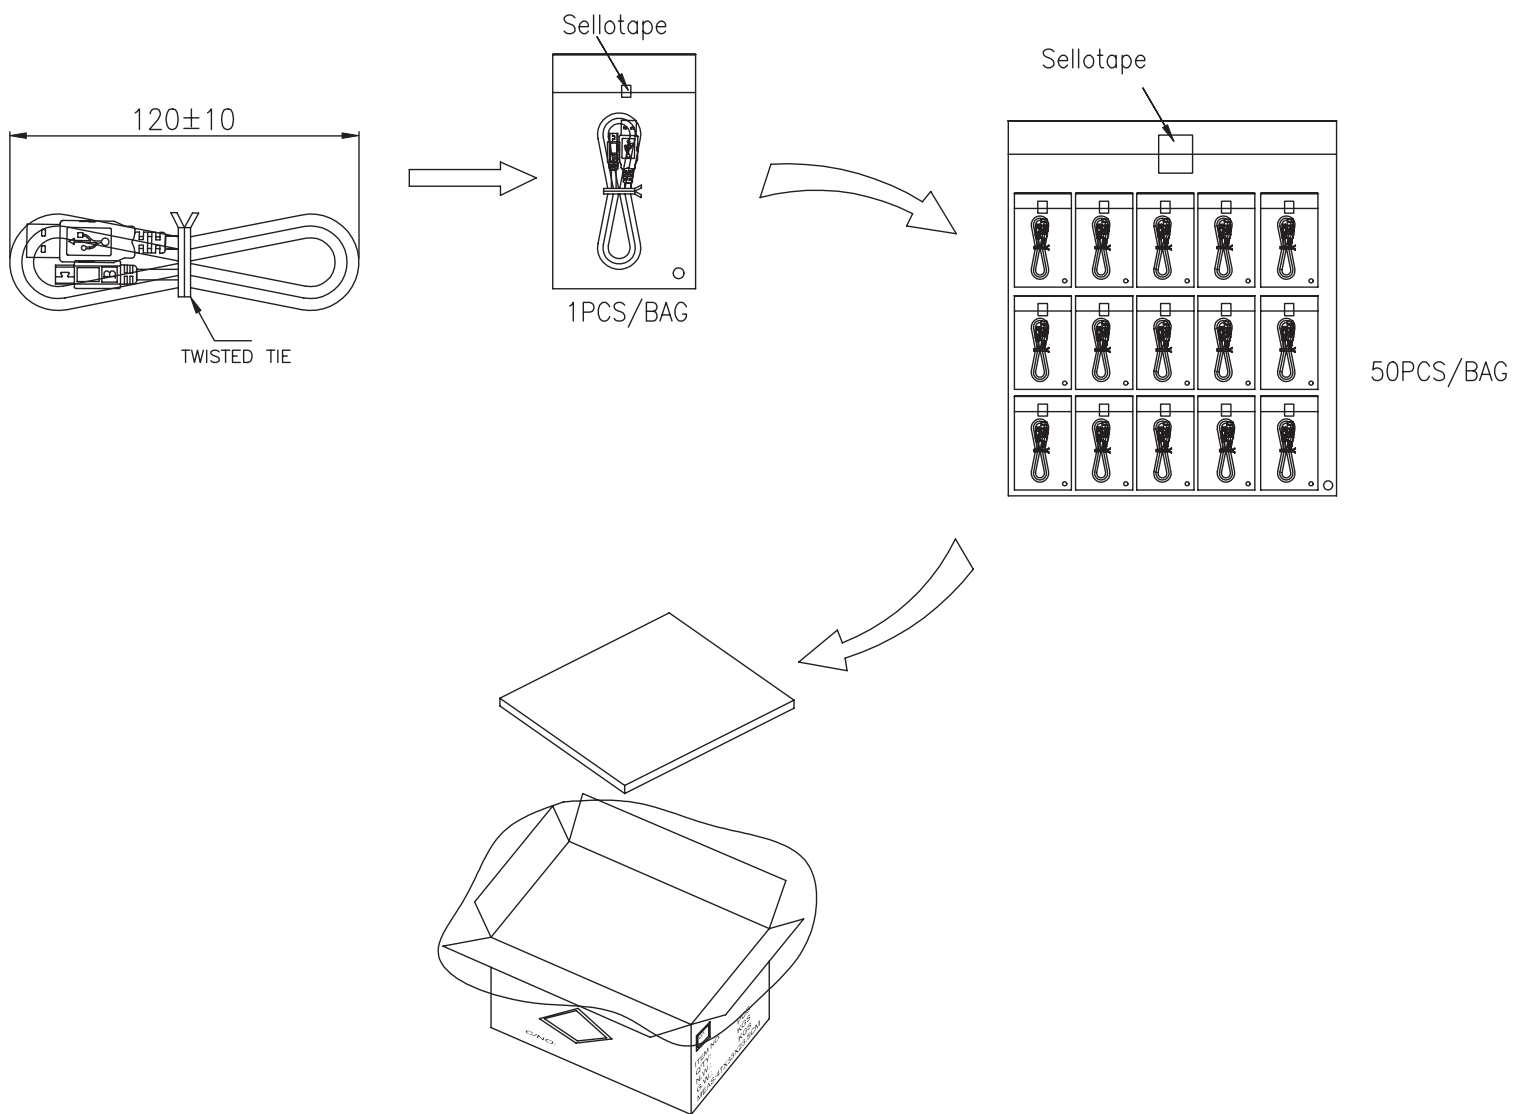

## REVISION HISTORY

---

rev.	description	date
1.0	initial release	12/21/2018
1.01	brand update	02/17/2020
1.02	changed overmold design	01/05/2021
1.03	updated packaging	01/28/2021

The revision history provided is for informational purposes only and is believed to be accurate.

---

# CUI DEVICES

CUI Devices offers a one (1) year limited warranty. Complete warranty information is listed on our website.

CUI Devices reserves the right to make changes to the product at any time without notice. Information provided by CUI Devices is believed to be accurate and reliable. However, no responsibility is assumed by CUI Devices for its use, nor for any infringements of patents or other rights of third parties which may result from its use.

CUI Devices products are not authorized or warranted for use as critical components in equipment that requires an extremely high level of reliability. A critical component is any component of a life support device or system whose failure to perform can be reasonably expected to cause the failure of the life support device or system, or to affect its safety or effectiveness.